
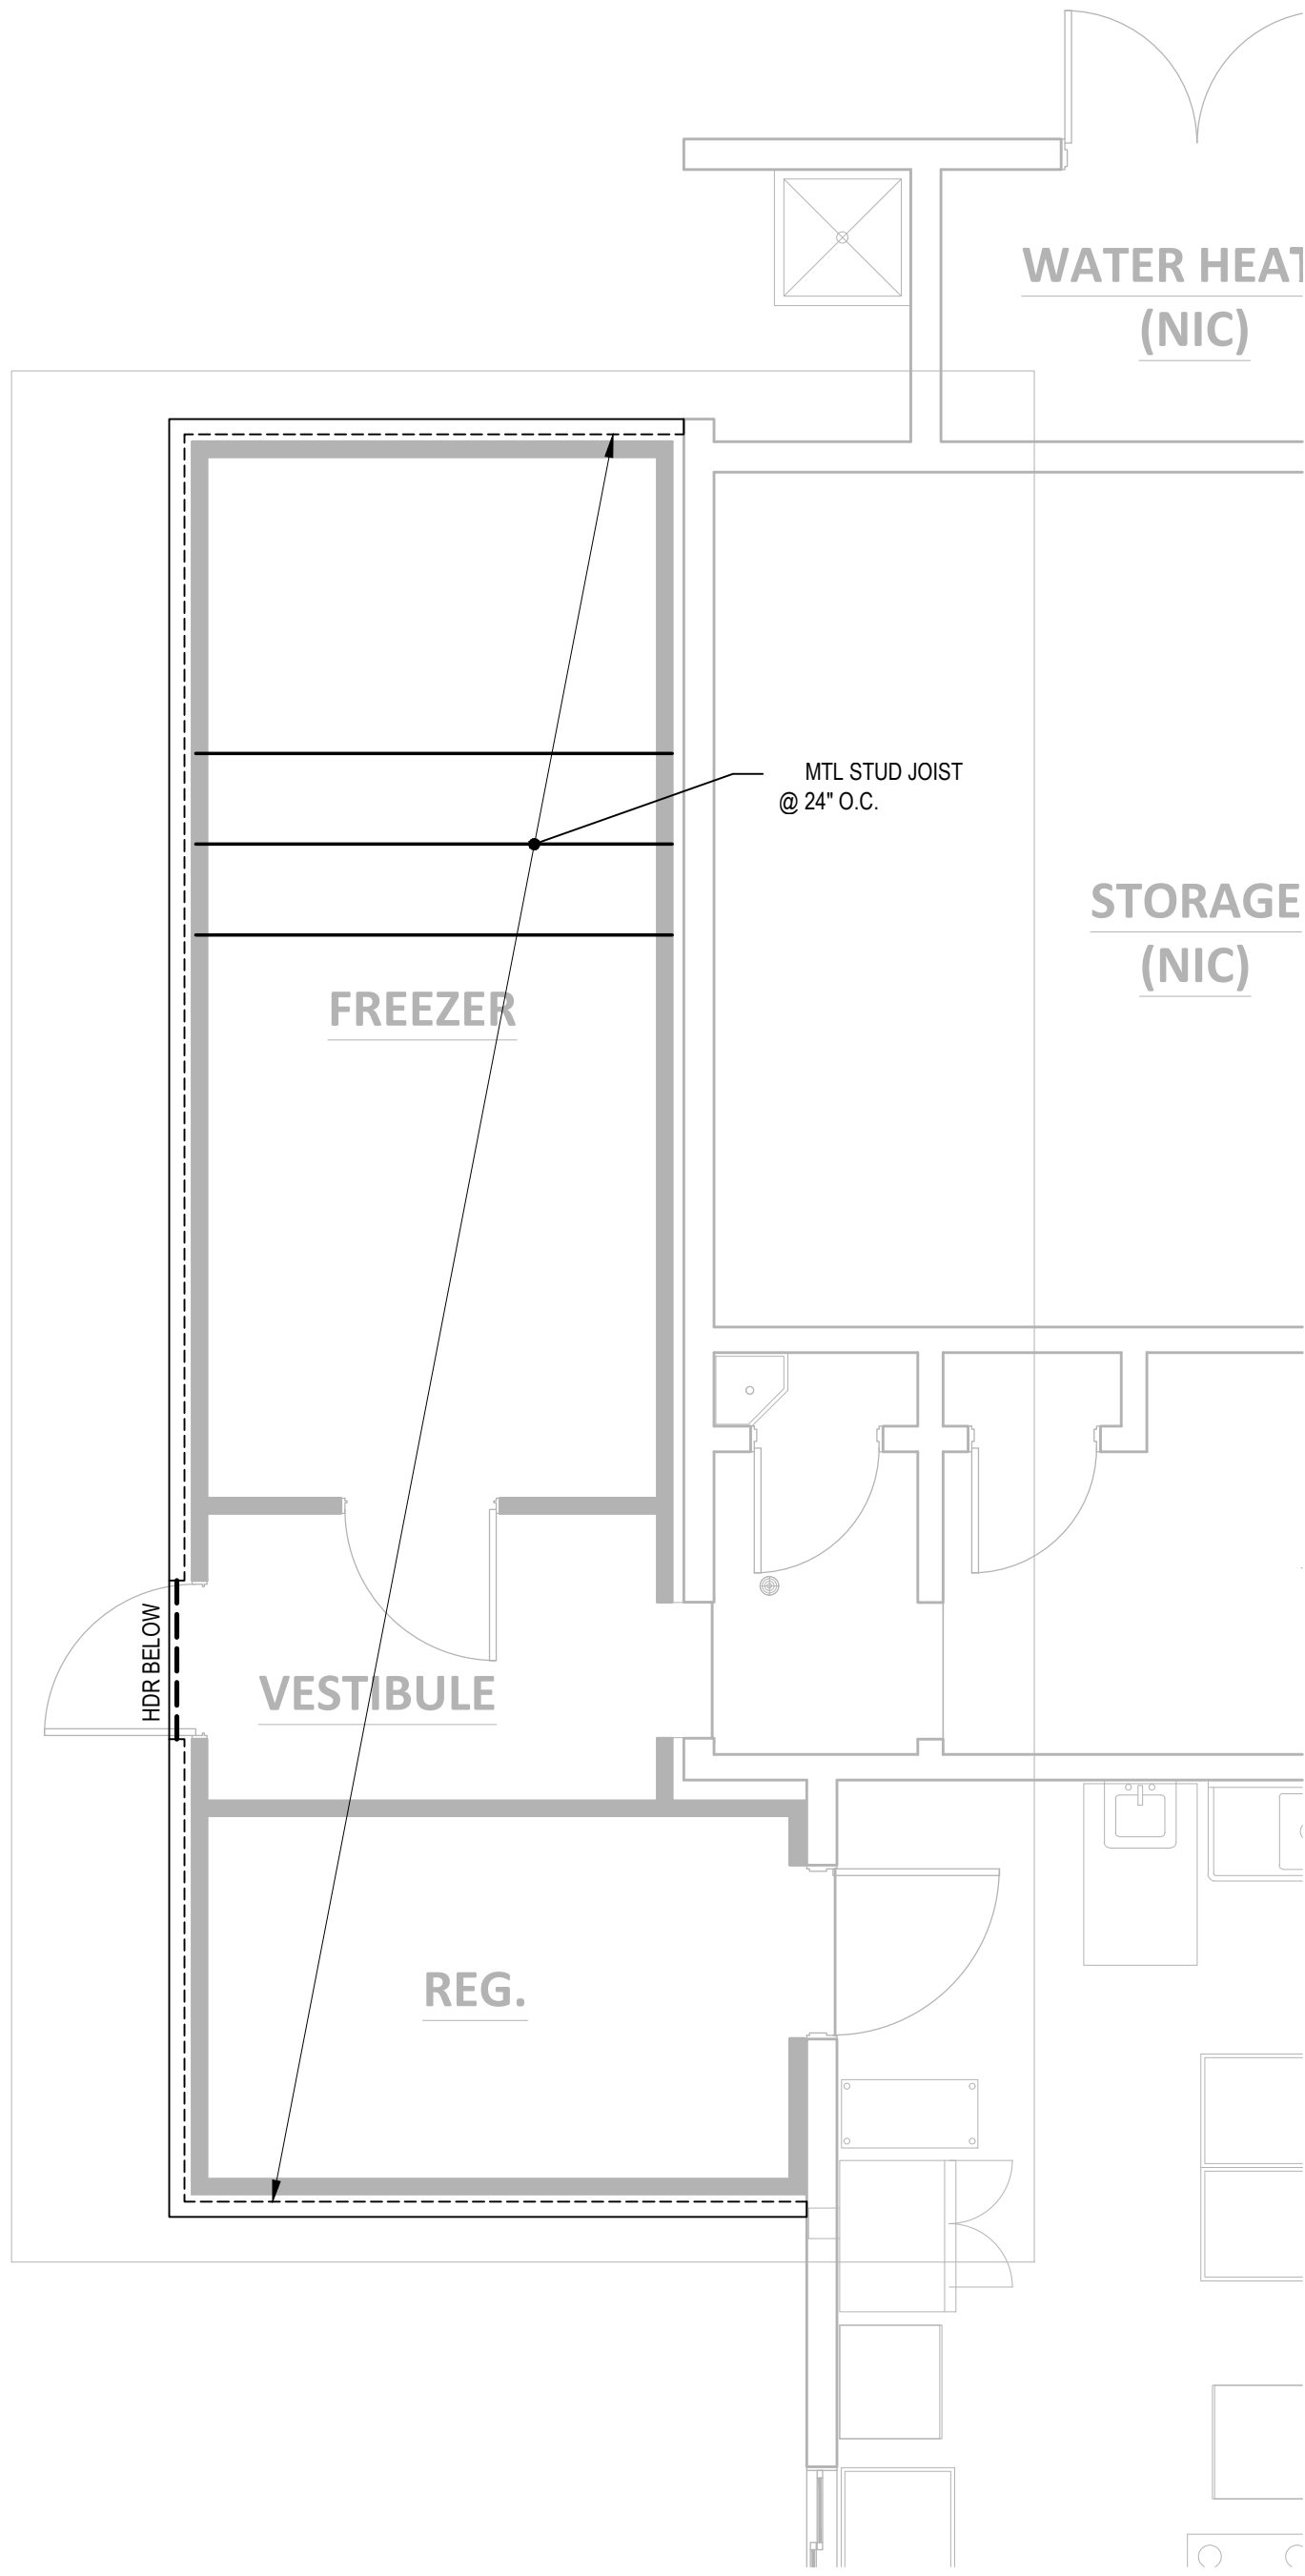


ROOF FRAMING NOTES:

1. WHERE SPACING OF BEAMS NOT INDICATED, PROVIDE EQUAL SPACING WITHIN EACH BAY.
2. COORDINATE W/ MECHANICAL DRAWINGS FOR LOCATION AND SIZES OF MECHANICAL EQUIPMENT AND OPENINGS.
3. FOR SIZE AND LOCATIONS OF CURBS AND SLAB OPENINGS, REFER TO ARCHITECTURAL OR MECHANICAL DRAWINGS.
4. FOR ROOF MOUNTED EQUIPMENT ANCHORAGE SCHEDULE SEE S.1.
5. WHERE 1 1/2", 18 GA. DECK IS INDICATED ON THE DRAWINGS, METAL DECK SHALL BE VERCO PLB-36 OR HSB-36 GALVANIZED OR APPROVED EQUAL.
MAX SPAN = 11'-0" WITH 3 SPAN MINIMUM
MAX SPAN = 11'-0" WITH 2 SPAN MINIMUM
MAX SPAN = 9'-0" WITH SINGLE SPAN. (APMO ESR 0217) U.O.N.
6. WHERE 3", 18 GA. DECK IS INDICATED ON THE DRAWINGS, METAL DECK SHALL BE VERCO PLB-36 OR HSB-36 GALVANIZED OR APPROVED EQUAL.
MAX SPAN = 14'-0" WITH 3 SPAN MINIMUM
MAX SPAN = 18'-0" WITH 2 SPAN MINIMUM
MAX SPAN = 12'-0" WITH SINGLE SPAN. (APMO ESR 0217) U.O.N.
7. MAX SOLAR PANEL ASSEMBLY WEIGHT = 10PSF.
PV PANEL MAX UPLIFT LOAD = 32 PSF (ULT)
8. AN ADDITIONAL 10 PSF FOR MECHANICAL UNITS HAS BEEN ACCOUNTED FOR OVER THE BACK OPEN AREA

ROOF FRAMING LEGEND:

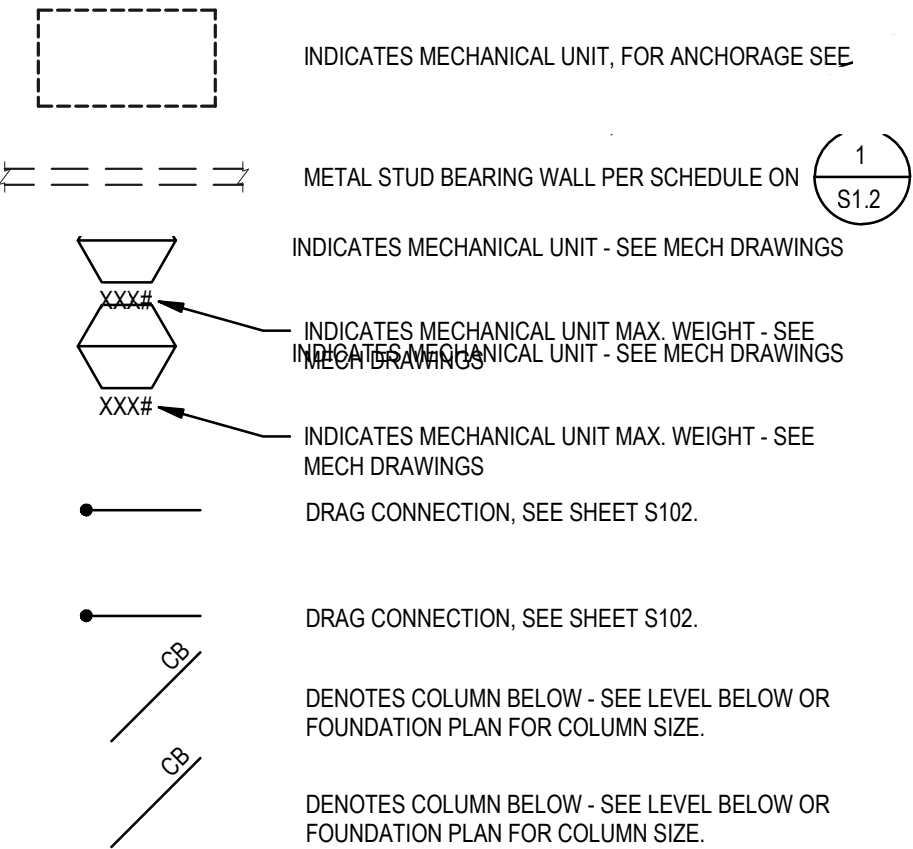

FRAMING PLAN

SCALE: 1/4"=1'-0"

2

FOUNDATION NOTES:

1. TOP OF CONC. SLAB = 0'-0" (ASSUMED), U.O.N. (795'-6" DATUM. VERIFY WITH CIVIL DWGS)
2. PRIOR TO THE CONTRACTOR REQUESTING BUILDING DEPARTMENT FOUNDATION INSPECTION, THE SOILS ENGINEER SHALL ADVISE THE BUILDING OFFICIAL IN WRITING THAT:

A. THE BUILDING PAD WAS PREPARED IN ACCORDANCE WITH THE SOILS REPORT.

B. THE UTILITY TRENCHES HAVE BEEN PROPERLY BACKFILLED AND COMPACTED

C. THE FOUNDATION EXCAVATIONS COMPLY WITH THE INTENT OF THE SOILS REPORT.
3. VERIFY ALL DIMENSIONS WITH ARCH'L DRAWINGS. SEE ARCH FOR DIMENSIONS NOT SHOWN.
4. CONFIRM ALL SLAB ELEVATIONS, STEPS, SLOPES AND OPENING WITH ARCHITECT AND M/E/P DRAWINGS. REPORT DISCREPANCIES TO STRUCTURAL ENGINEERS.
5. SEE GENERAL NOTES AND TYP. DETAILS FOR INFO NOT REFERENCED. TYPICAL DETAILS SHALL BE FOLLOWED WHERE APPLICABLE. WHETHER OR NOT THEY ARE REFERENCED ON PLAN.
6. FOR ITEMS NOT NOTED OR REFERENCED ON PLAN, SEE STRUCTURAL NOTES AND TYPICAL DETAILS.
7. SEE ARCHITECTURAL DRAWINGS FOR

A) SLAB EDGE DIMENSION



B) OPENING SIZES AND LOCATIONS

C) SLOPES AND DEPRESSION SIZES AND LOCATIONS

D) SLAB ELEVATIONS

E) CURB LOCATIONS
8. COLUMNS ARE CENTERED ON GRID LINES UNLESS DIMENSIONED OTHERWISE
9. TOP OF FOOTING IS (-1'-6") BELOW TOP OF SLAB ON GRADE, TYP. U.O.N.

FOUNDATION LEGEND:

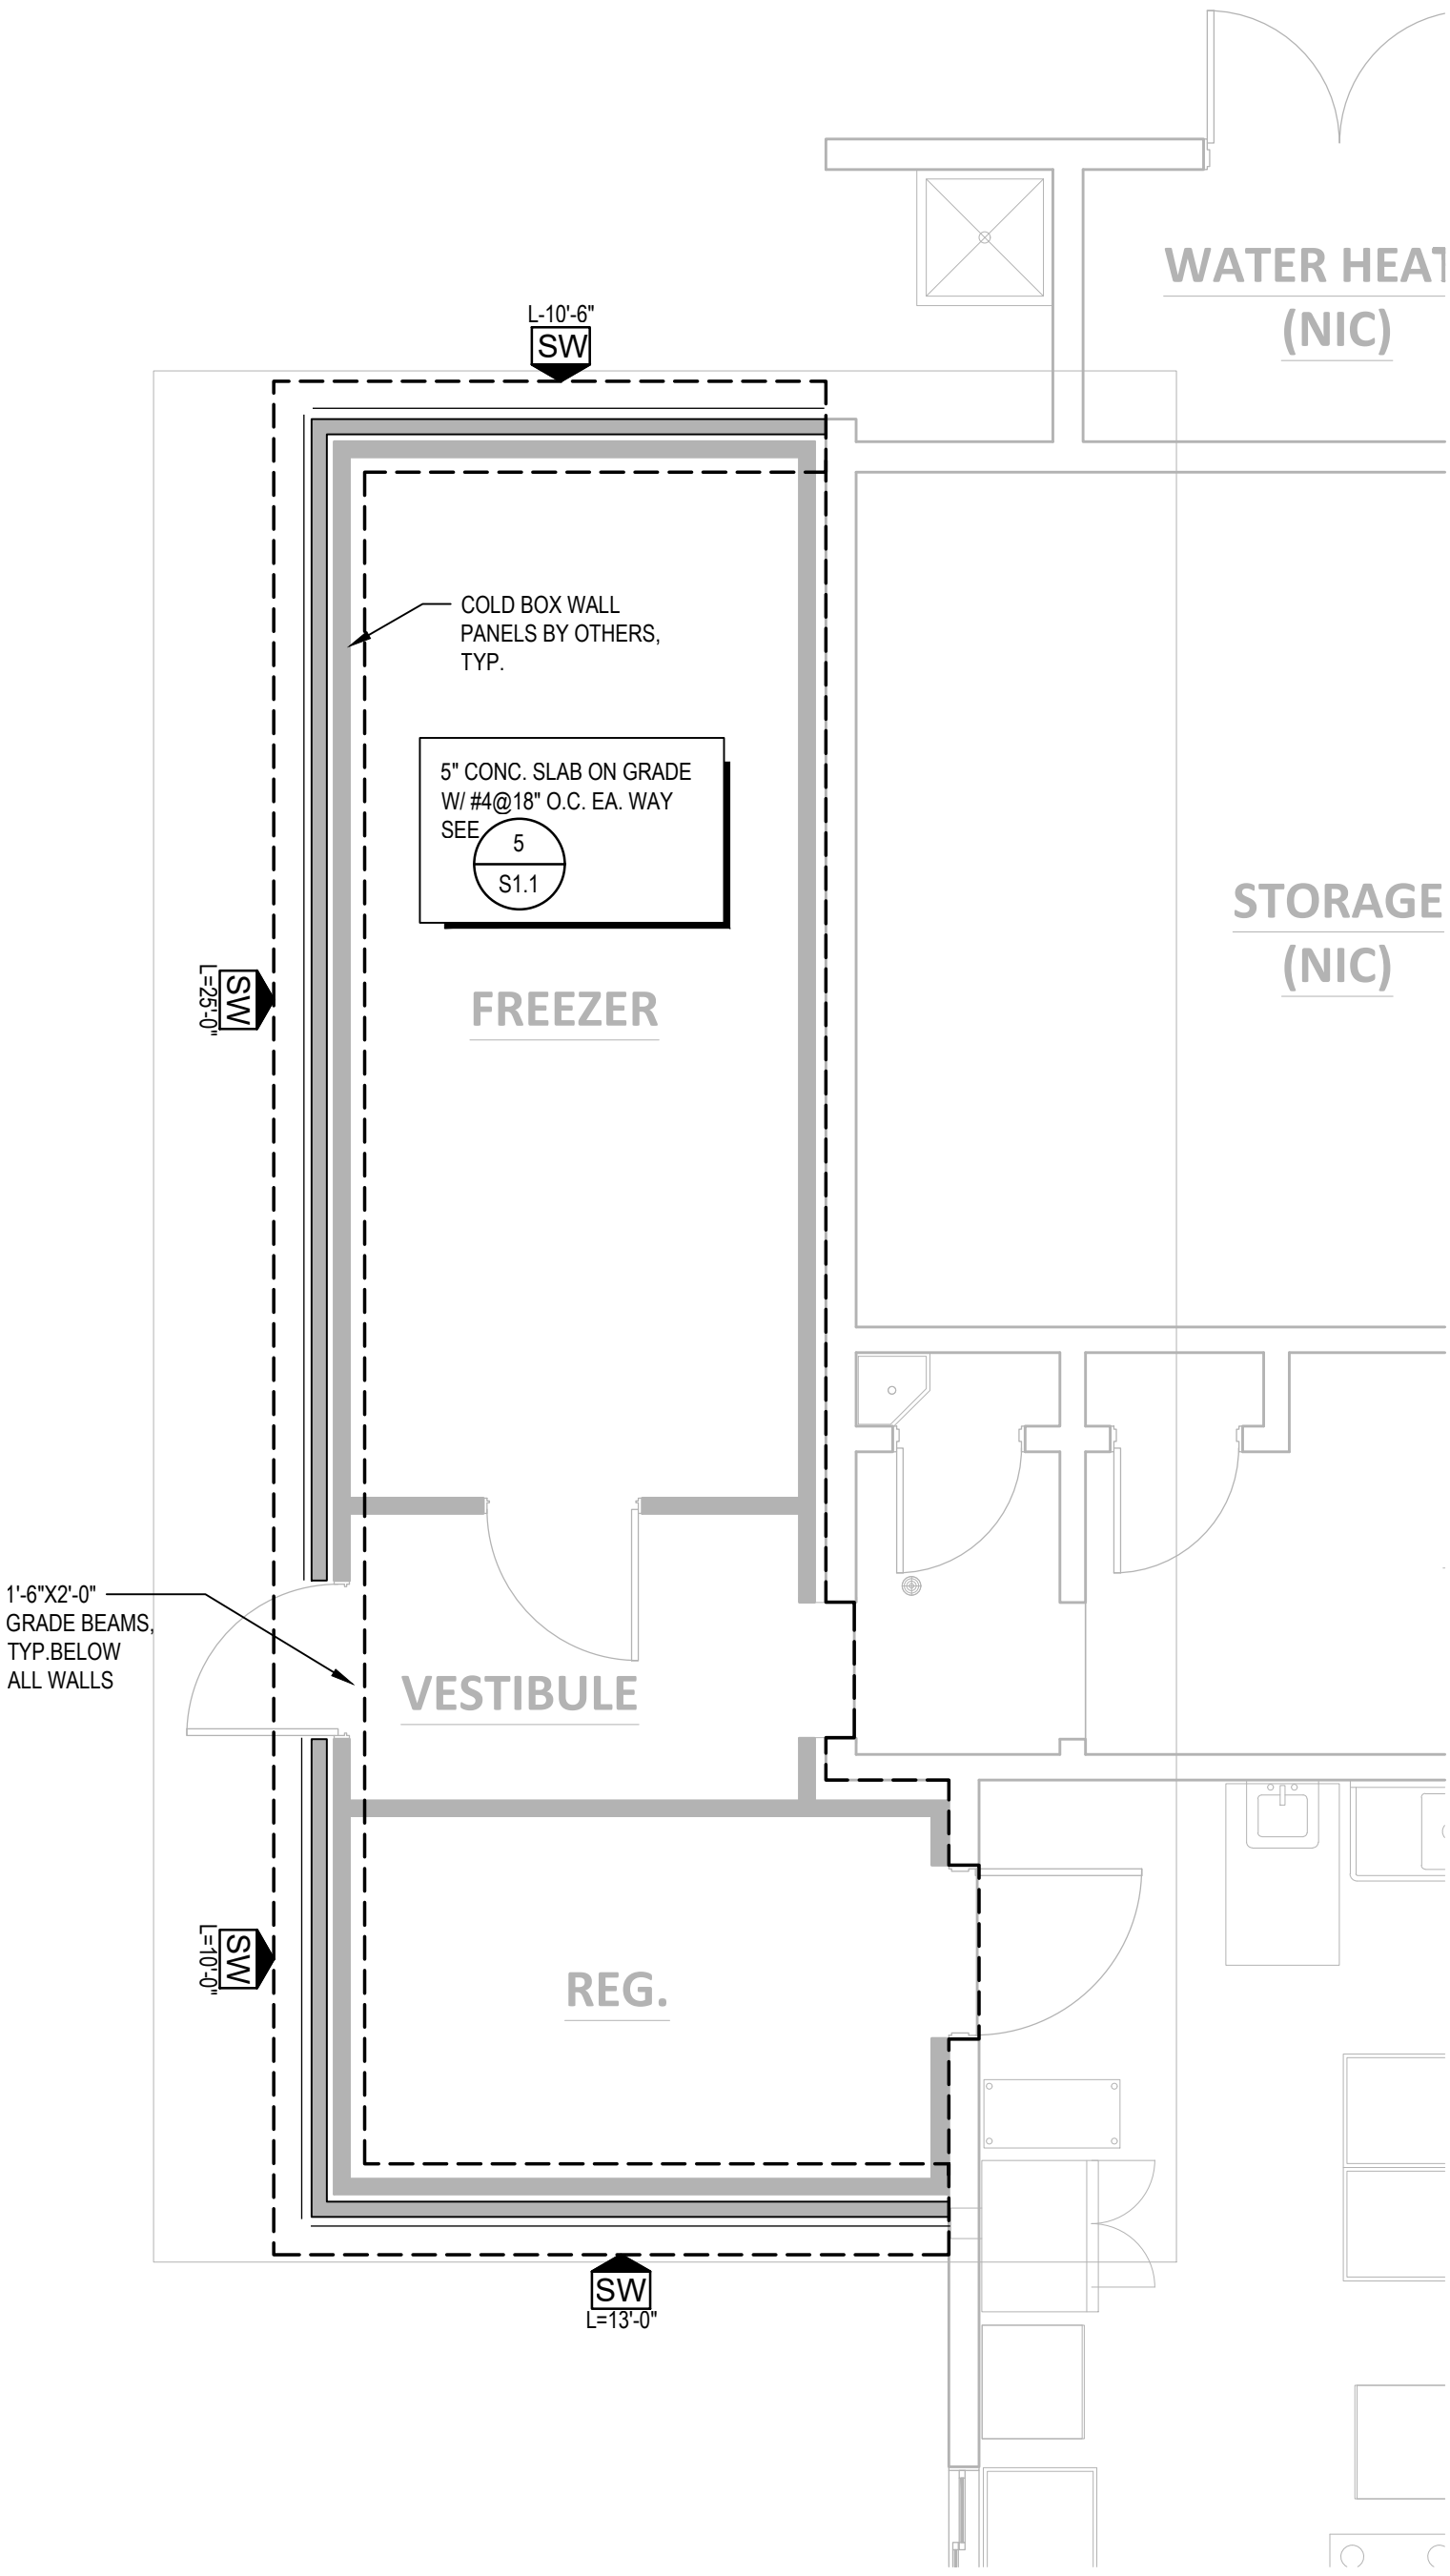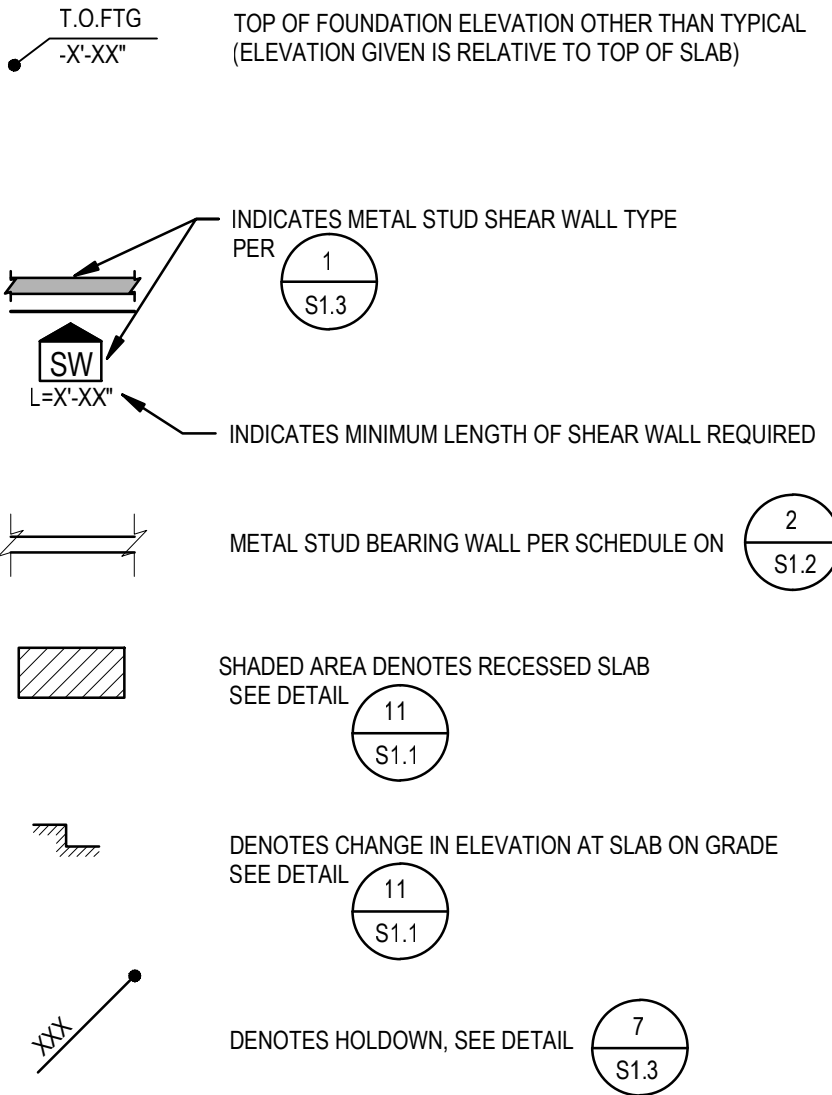

FOUNDATION PLAN

SCALE: 1/4"=1'-0"

1

BOARD OF EDUCATION

PREPARED FOR THE

FOUNDATION & FRAMING PLAN

ob/ARCHITECTURE
2419 EL CAJON BLVD., SAN DIEGO, CA 92104

PREPARED BY THE

SAN DIEGO UNIFIED SCHOOL DISTRICT
KITCHEN MODIFICATIONS GROUP 6
BELL MIDDLE SCHOOL
620 BRIARWOOD RD.,
SAN DIEGO, CA 92139
BID SET

PROJECT NO. SDUF-002

DATE 04/12/25

REVISIONS

SHEET NO.

S2.1

COFFMAN ENGINEERS
1455 Frazee Rd., Suite 600
San Diego, CA 92108
ph 619.232.4673
www.coffman.com

FOR DSA REVIEW ONLY -
NOT FOR CONSTRUCTION

obr
ARCHITECTURE
ART
DESIGN

SAN DIEGO UNIFIED SCHOOL DISTRICT
100 SCHOOLS